


12/02/2025

C:\Users\JGreen\Documents\Carn Fearna DWGS\402.064563.00001.0008 - CF - Figure 3.14 - Indicative Cable Trench Detail.dwg

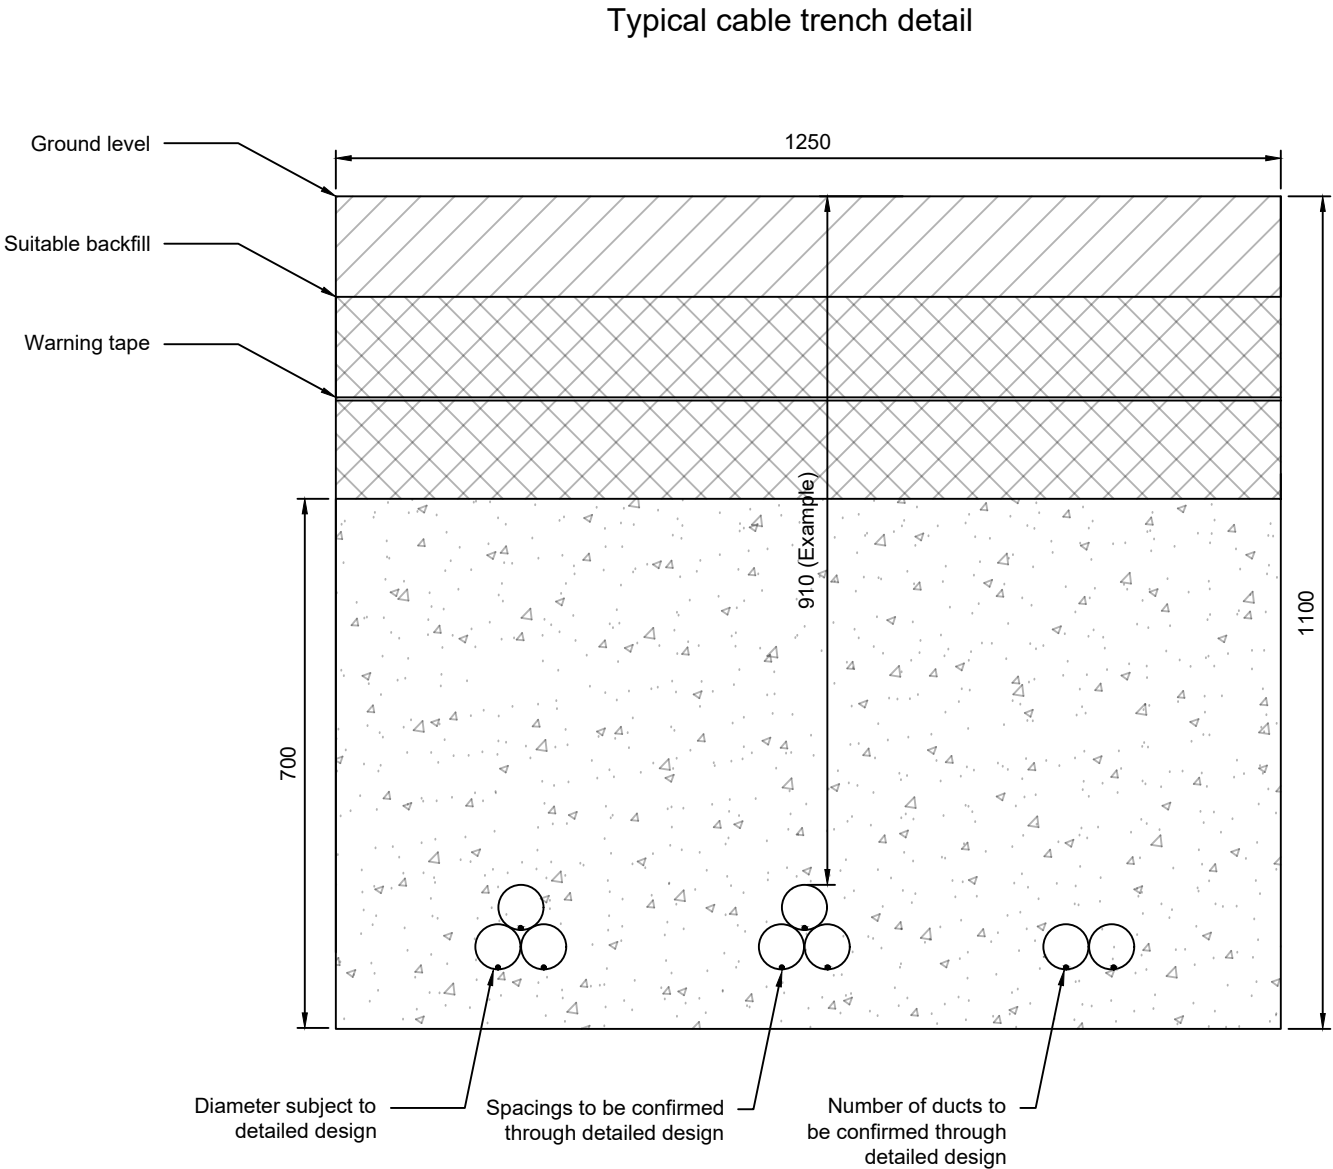

Surface type	Voltage		
	33kV	11kV	Low Voltage
	Minimum depth of cover (mm)		
Unmade ground, footways and footpaths	775	600	450
Roads	775	700	600
Cultivated grounds	775	700	600
Agricultural land	910	910	910

- Notes:
1. Subject to change through detailed design.
  2. Cable dimensions and spacings to be confirmed after detailed design.
  3. Dimensions of cable depths to be confirmed after detailed design.
  4. Bedding and cable cover surround to be confirmed after detailed design.
  5. Dimensions in mm.
  6. Not to scale.

Legend:

Rev	Amendments	Date	By	Chk	Auth
-----	------------	------	----	-----	------



www.slrconsulting.com



Project  
CARN FEARNA WIND FARM  
ENVIRONMENTAL IMPACT ASSESSMENT  
REPORT

Figure Title  
INDICATIVE CABLE TRENCH DETAIL

Scale NTS @ A3	SLR Project No. 402.064563.00001.0008
-------------------	--

Designed SRB	Drawn RA	Checked RA	Authorised DK
-----------------	-------------	---------------	------------------

Date	Date 10/12/24	Date 10/12/24	Date 10/12/24
------	------------------	------------------	------------------

Figure Number 3.14	Rev. 0
-----------------------	-----------